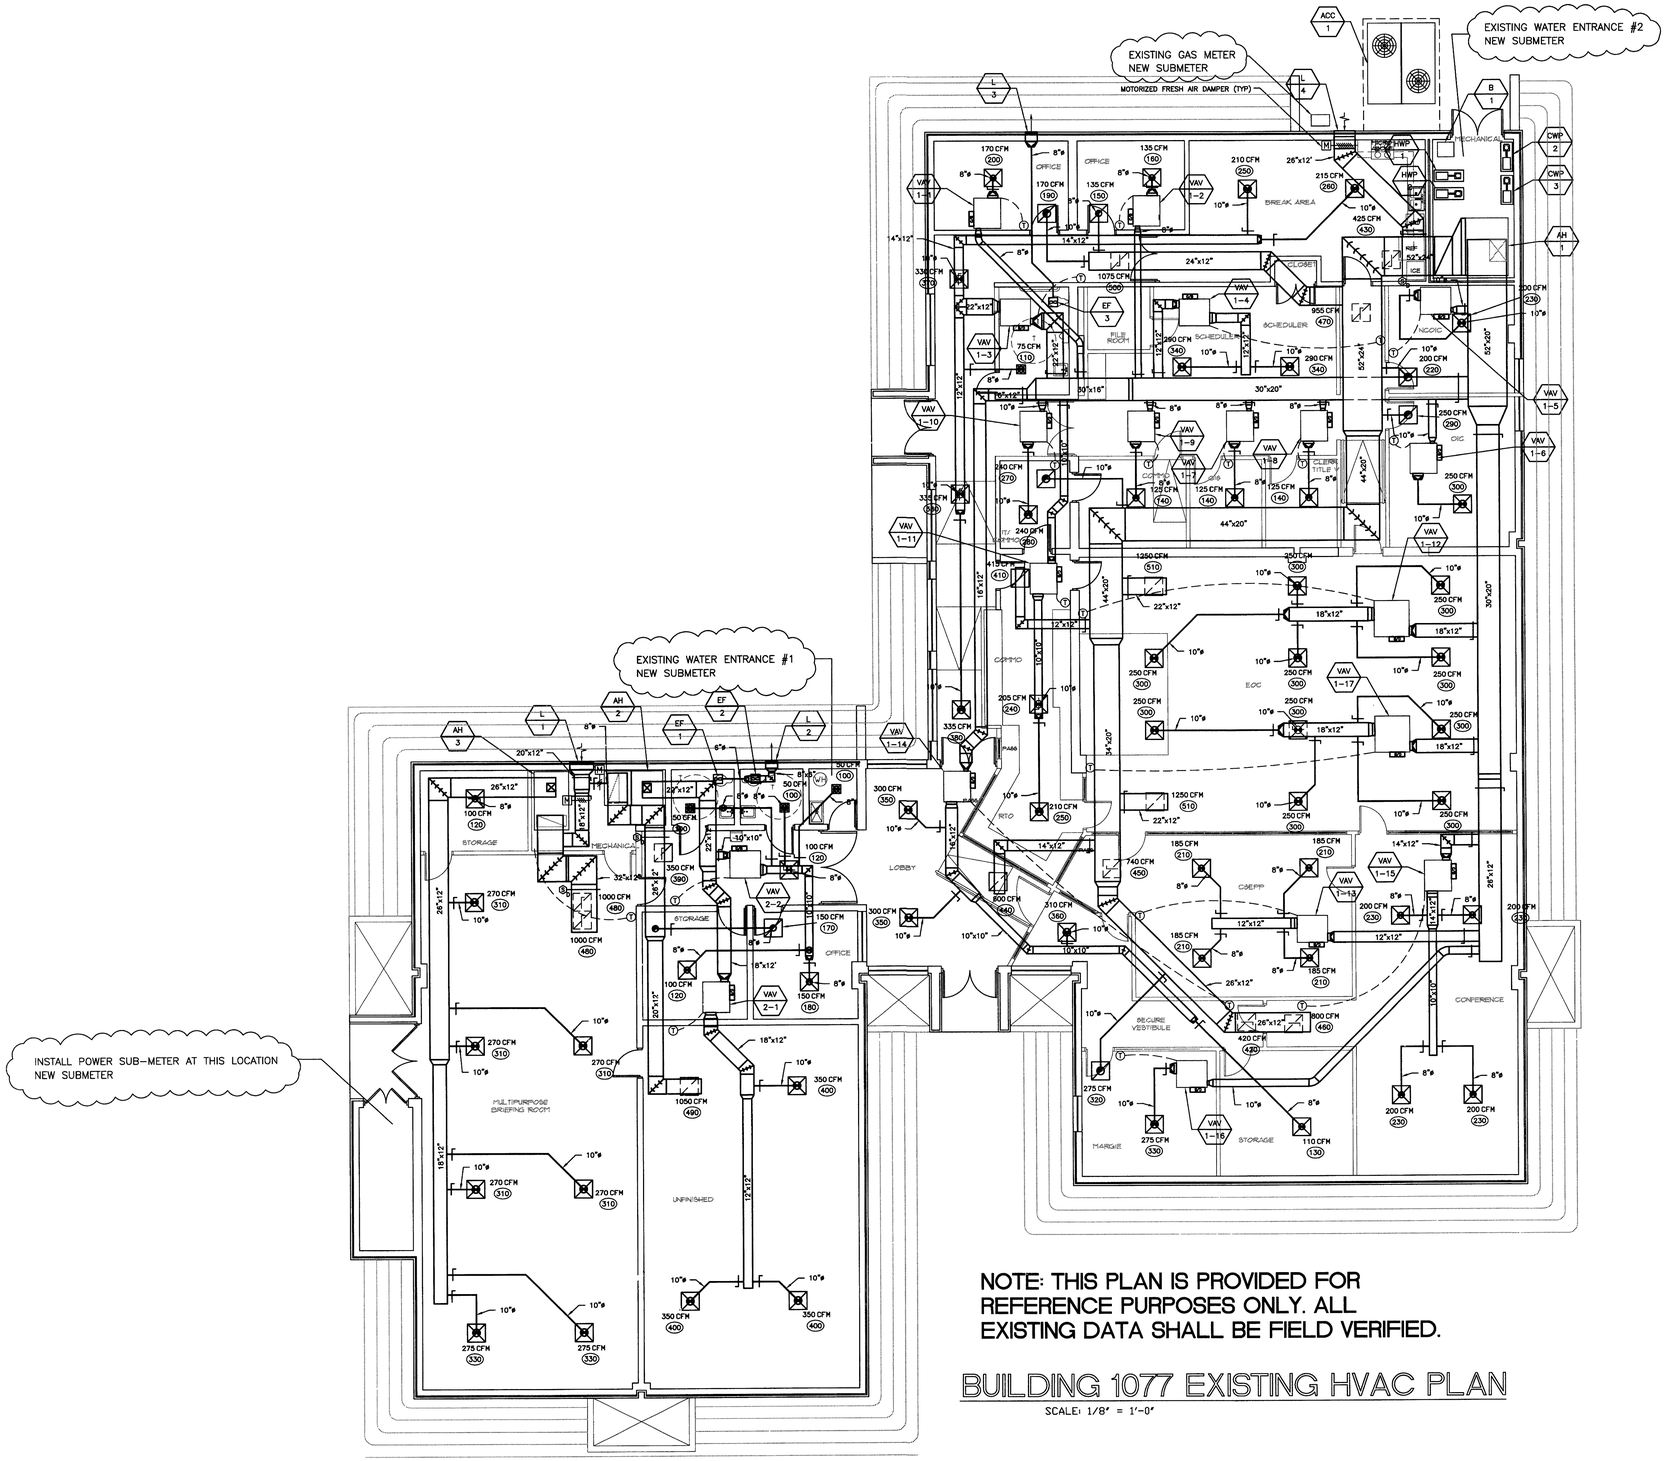

NOTE: THIS PLAN IS PROVIDED FOR REFERENCE PURPOSES ONLY. ALL EXISTING DATA SHALL BE FIELD VERIFIED.

BUILDING 1077 EXISTING HVAC PLAN

SCALE: 1/8" = 1'-0"

BUILDING 1077 HVAC BUILDING AUTOMATION PLAN

BUILDING 1077 - NEW WORK
DDC SYSTEM NOTES

1. EXISTING BUILDING AUTOMATION SYSTEM SHALL BE UPGRADED TO HONEYWELL WEBS AX.
2. BUILDING AUTOMATION CONTRACTOR SHALL INSTALL WATER SUB-METER, GAS SUB-METER, AND POWER SUB-METER FOR INTERFACE WITH THE BUILDING AUTOMATION SYSTEM TO OBTAIN TOTAL ENERGY ON THE BUILDING.
3. POWER SUB-METER INSTALLATION SHALL BE INSTALLED AT MAIN POWER PANEL REFERENCE PLANS FOR LOCATION.
   WATER SUB-METER INSTALLATION SHALL BE INSTALLED INSIDE BUILDING AT WATER ENTRANCE (2 SUB-METERS REQUIRED). REFERENCE PLANS FOR LOCATION.
4. COORDINATE SUB-METER INSTALLATION WITH LOCAL OFFICE, KERRY GOTT 256-543-1815.
5. CONTRACTOR SHALL FIELD VERIFY QUANTITY OF ALL EXISTING UNITS.
6. INSTALLATION OF GAS METER SHALL INCLUDE METER BYPASS. BYPASS PIPING SHALL BE FULL SIZE OF PIPE MAIN AND SHALL INCLUDE ISOLATION VALVES.

WHORTON ENGINEERING, INC.
HVAC – PLUMBING – PROCESS CONTROL
RANDALL WHORTON, P.E.
PH 256/820-9897 FAX 256/820-9896
25 SUMMERALL GATE ROAD
ANNISTON, ALABAMA 36205
ALABAMA REGISTERED PROFESSIONAL ENGINEER No.14192 RANDALL D. WHORTON

WHORTON ENGINEERING PROJECT NO. 09192

2WR | HolmesWilkins ARCHITECTS
166 Commerce Street
P.O. Box 4834
Montgomery, AL 36104
Phone: (334)263-6400
Fax: (334)263-6406
STATE OF ALABAMA
W. MICHAEL WATSON 1828
J. MICHAEL SUTLAND 2149
TIMOTHY R. HOLMES 3166
BERT WILKINS III 3079
REGISTERED ARCHITECT

ENERGY CONSERVATION BUILDING #1062, #2262, #1220 & #1077 AL ARNG TRAINING SITE
IFB NO. AC-09-B-0039-S
Ft. McClellan
Anniston, Alabama

CONSTRUCTION DOCUMENTS

Project Number: 819
Date: August 18, 2009
Revisions:

Sheet Description

BUILDING 1077 HVAC BUILDING AUTOMATION PLAN

Sheet Number

M4.1